

NOTES:

ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH ALL STATE, AND LOCAL, GOVERNING CODES AND REGULATIONS.

ALL Poured CONCRETE SHALL BE OF A DESIGN MIX HAVING A MINIMUM COMPRESSIVE STRENGTH OF 2500 PSI AT 28 DAYS


UNLESS NOTED OTHERWISE, ALL FRAMING LUMBER SHALL BE DOUGLAS-FIR, NO. 2 GRADE HAVING A MINIMUM ALLOWABLE BENDING STRESS OF 1450 PSI.

ADD 4" GYPSUM BOARD TO EXISTING DIVIDING WALLS BETWEEN APARTMENTS TO MEET 1 HR. FIRE RATED CONSTRUCTION.

**Existing Conditions  
as of October 12, 2023  
Inspection.**

**Note:** ACCESSORY APARTMENT ENTRY SHALL BE LIGHTED FROM WITHIN (NO VISIBLE EXTERIOR WALL MOUNTED FIXTURES TO BE USED)

**Required Interior Light**

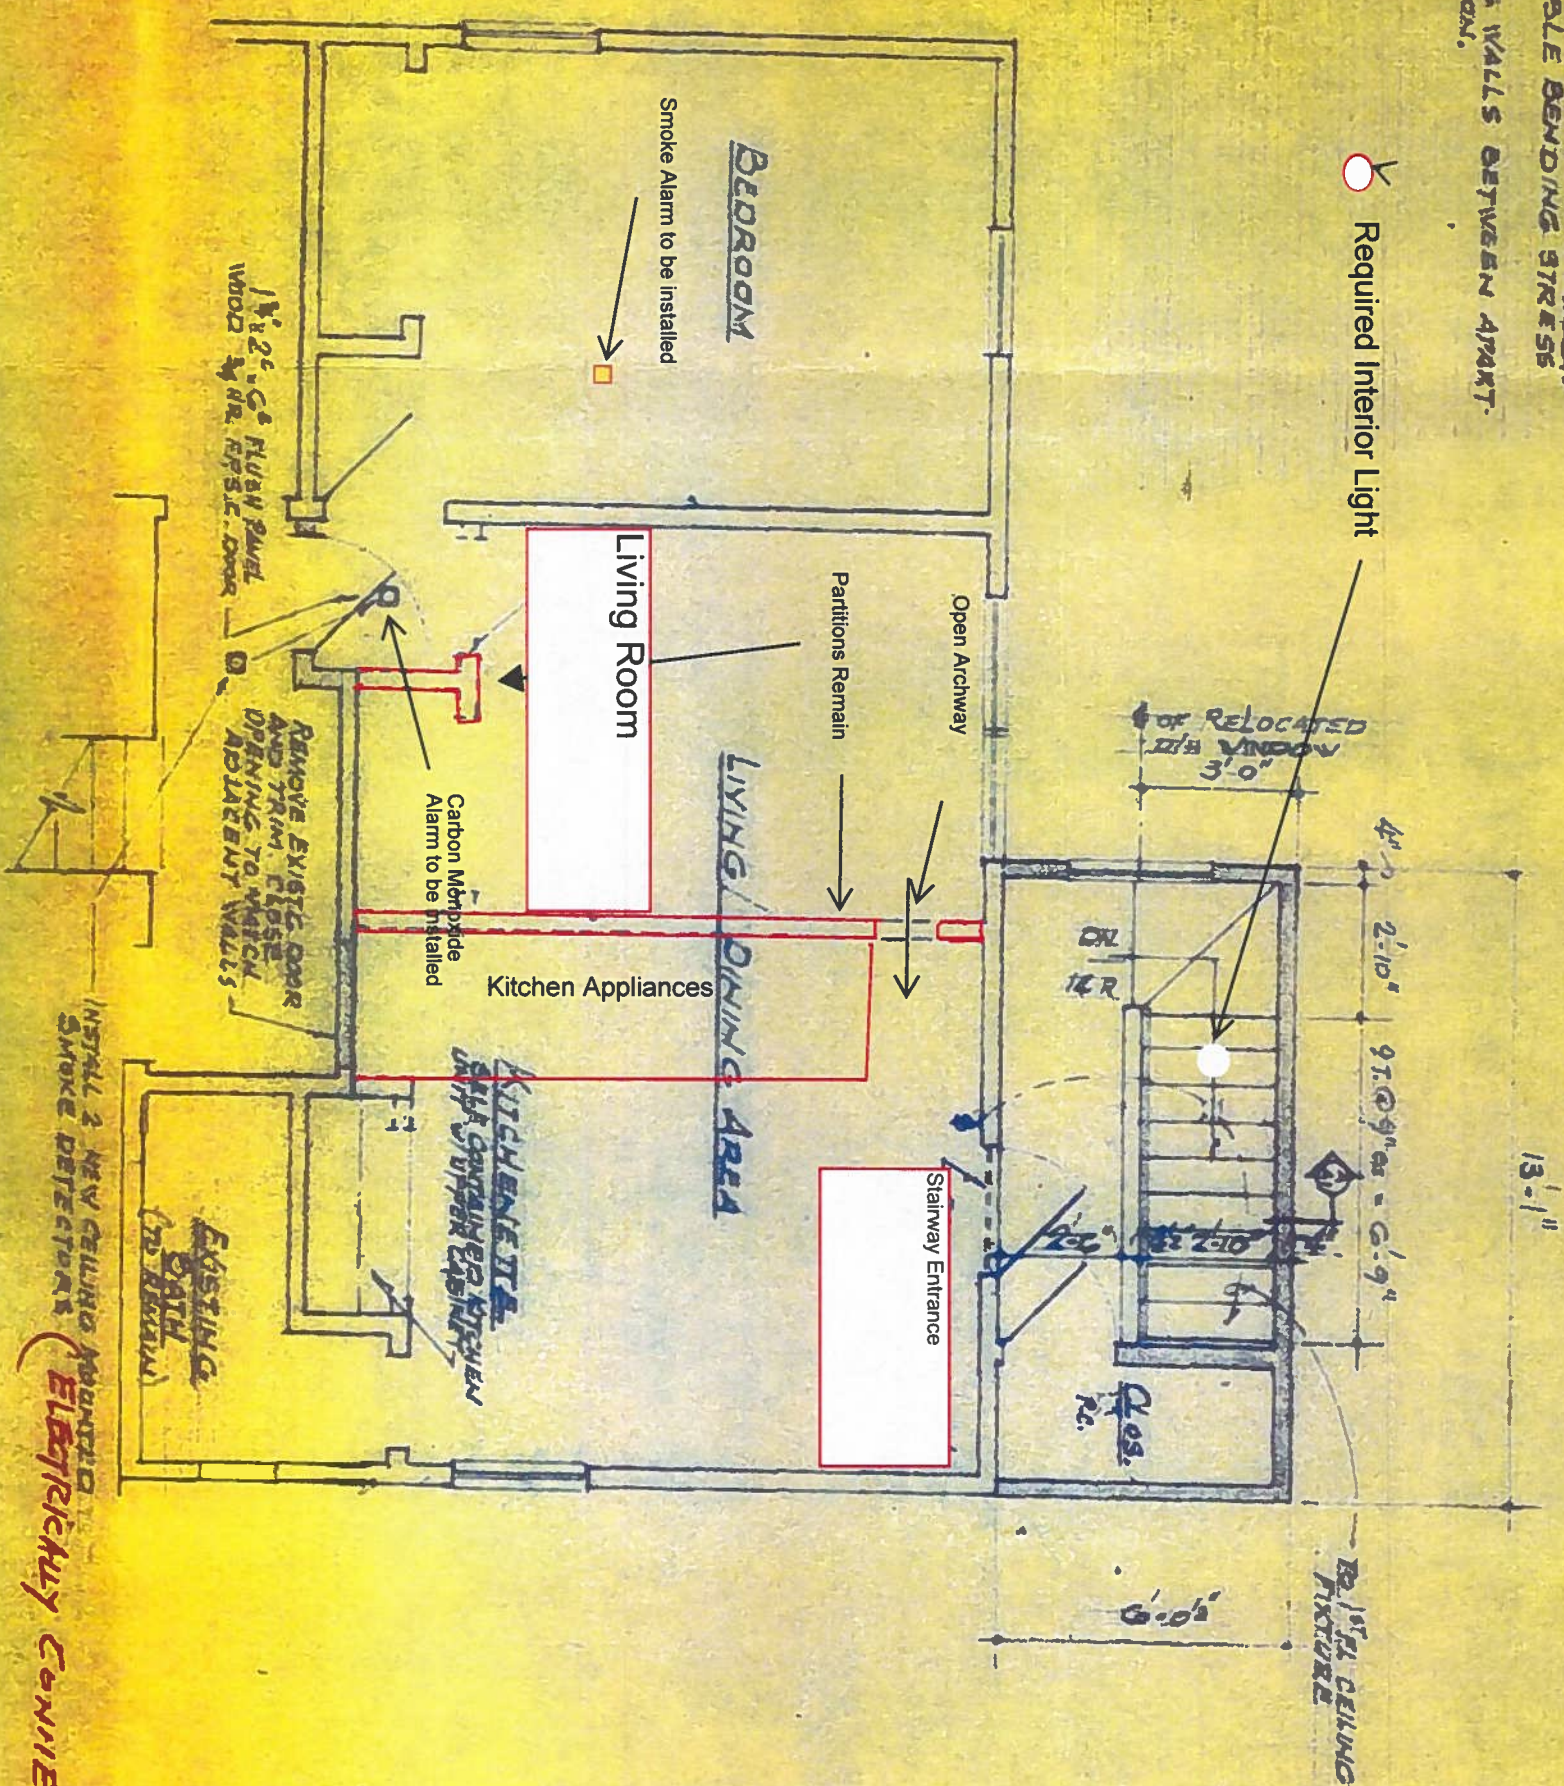

INSTALL 2 NEW CELLULOSE MONITORED  
SMOKE DETECTORS (ELECTRICALLY CONNIECTED)