



1. STONE SIZE – USE 2" STONE, OR RECLAIMED OR RECYCLED CONCRETE EQUIVALENT.
2. LENGTH – NOT LESS THAN 50 FEET.
3. THICKNESS – NOT LESS THAN (6) INCHES.
4. WIDTH – TWELVE (12) FEET MINIMUM. BUT NOT LESS THAN THE FULL WIDTH AT POINTS WHERE INGRESS AND EGRESS OCCURS. TWENTY-FOUR (24) FOOT IF SINGLE ENTRANCE TO SITE.
5. FILTER CLOTH – WILL BE PLACED OVER THE ENTIRE AREA PRIOR TO PLACING OF STONE.
6. SURFACE WATER – ALL SURFACE WATER FLOWING OR DIVERTED TOWARD CONSTRUCTION ENTRANCES SHALL BE PIPED ACROSS THE ENTRANCE. IF PIPING IS IMPRACTICAL, A MOUNTABLE BERM WITH 5:1 SLOPES WILL BE PERMITTED.
7. MAINTENANCE – THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHT-OF-WAY. ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACKED ONTO PUBLIC RIGHTS-OF-WAY MUST BE REMOVED IMMEDIATELY.
8. WHEN WASHING IS REQUIRED IT SHALL BE DONE ON AN AREA STABILIZED WITH STONE AND WHICH DRAINS INTO AN APPROVED SEDIMENT TRAPPING DEVICE.

MATERIALS FOR FABRICATED SILT FENCE:
POSTS: STEEL, EITHER "T" OR "U" TYPE OR 2" HARDWOOD
FILTER CLOTH: REFER TO NYDOT APPROVED MATERIALS
LIST FOR GEOTEXTILES.
PREFABRICATED UNIT: REFER TO NYDOT APPROVED
MATERIALS LIST FOR GEOTEXTILES.


1. FILTER CLOTH TO BE FASTENED SECURELY TO WOVEN WIRE FENCE WITH TIES SPACED EVERY 24" AT TOP AND MID SECTION.
2. WHEN TWO SECTIONS OF FILTER CLOTH ADJOIN EACH OTHER THEY SHALL BE OVERLAPPED BY 6" AND FOLDED.
3. MAXIMUM ALLOWABLE SLOPE LENGTHS CONTRIBUTING RUNOFF TO A SILT FENCE ARE:

4. MAXIMUM DRAINAGE AREA FOR OVERLOAD FLOW TO A SILT FENCE SHALL NOT EXCEED 1/2 ACRE PER 100 FEET OF FENCE.

NTS




NTS

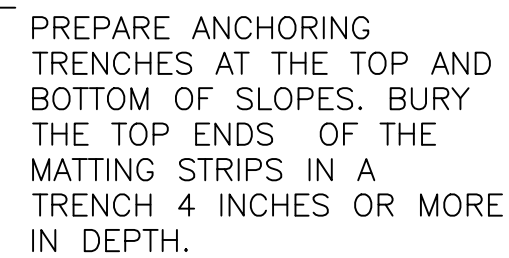


TAMP THE TRENCH FULL OF SOIL SECURE WITH ROW OF STAPLES. 10 INCH SPACING 4 INCHES DOWN FROM THE TRENCH.

INCH OVERLAP

OVERLAP-BURY UPPER END
OF LOWER STRIP AS IN "A"
AND "B". OVERLAP END OF
TOE STRIP 4 INCHES AND
STAPLE AT 10 INCH
INTERVALS.

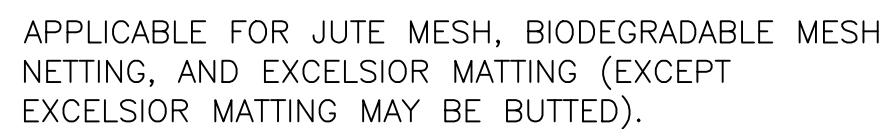

NOTE:
LIME, FERTILIZER, AND SEED IN ACCORDANCE WITH THE
APPLICABLE SEEDING STANDARD EXCEPT THAT FOR JUTE
MESH, 1/2 OF THE SEED MAY BE APPLIED PRIOR TO LAYING
THE MATTING AND THE REMAINING SEED APPLIED AFTER
LAYING THE MATTING.

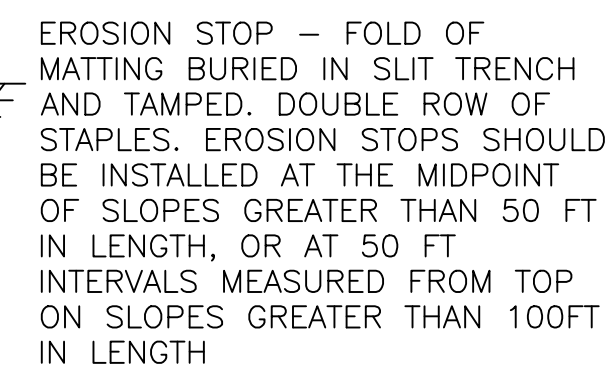

NTS

#8 GAUGE WIRE



NTS





NTS

NTS





- ## 95% SUBMISSION

C:\pwworking\gfpw01\rboutin\d1137415\CIV-003.dwg
11/2/2022 11:57:35 AM by BOUTIN, RYAN E.
11/7/2022

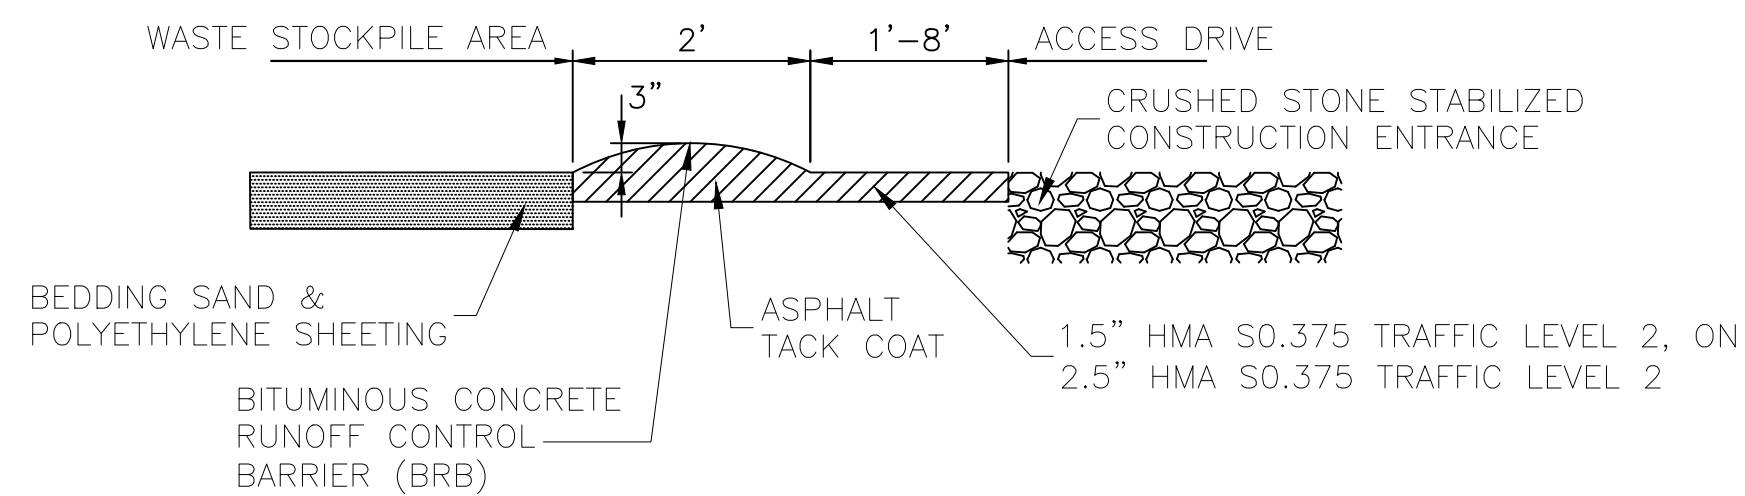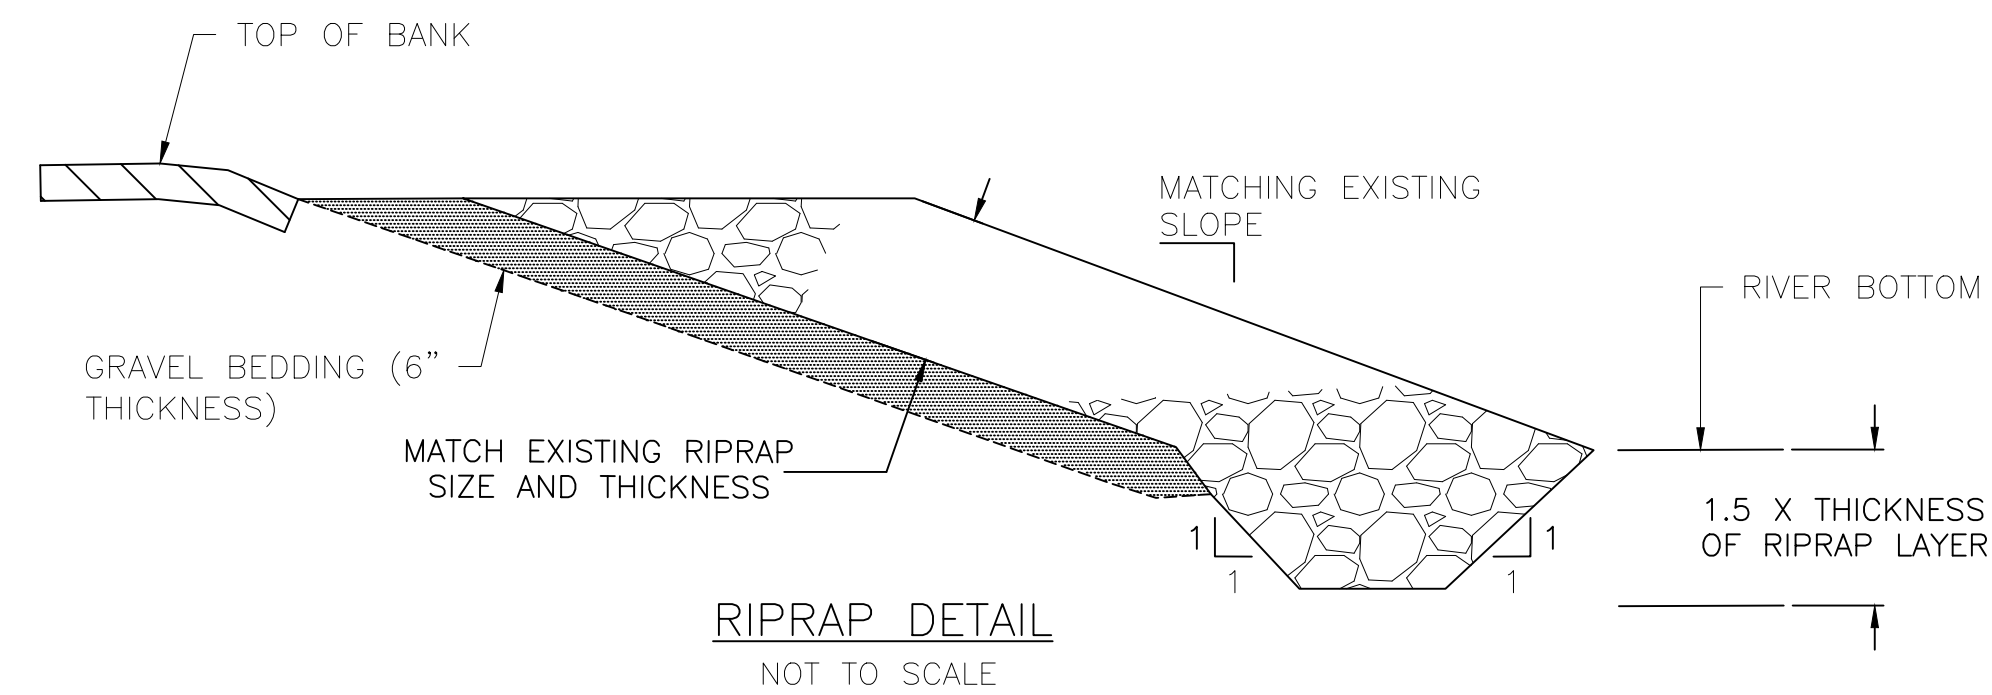



NOTES:

1. INSTALLATION OF BRB SHALL BE ON PAVEMENT ONLY AND IS BASED ON FIELD CONDITIONS OR AS DETERMINED BY THE ENGINEER.

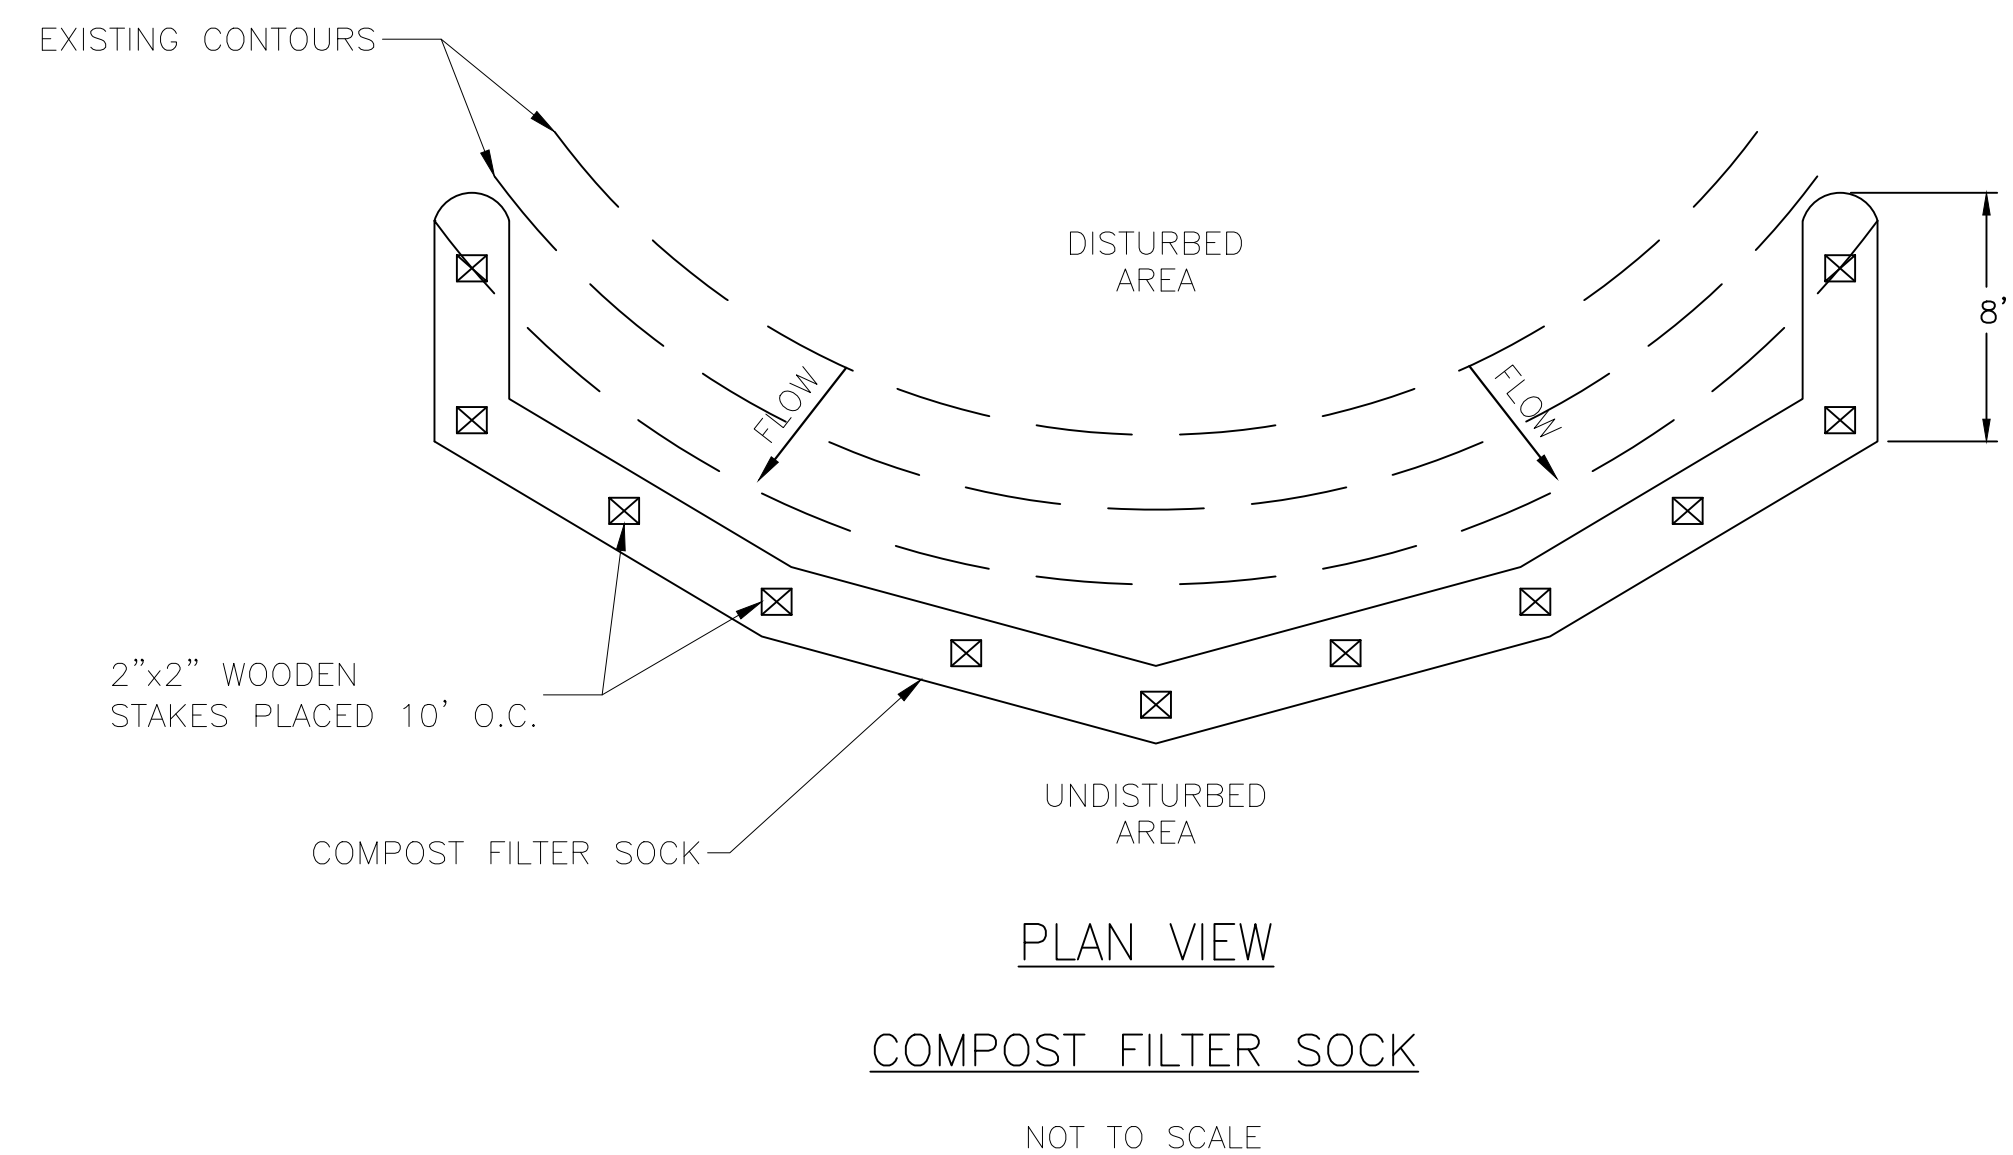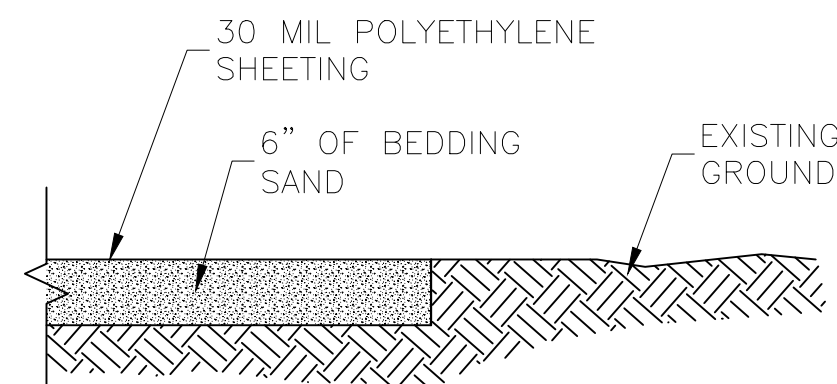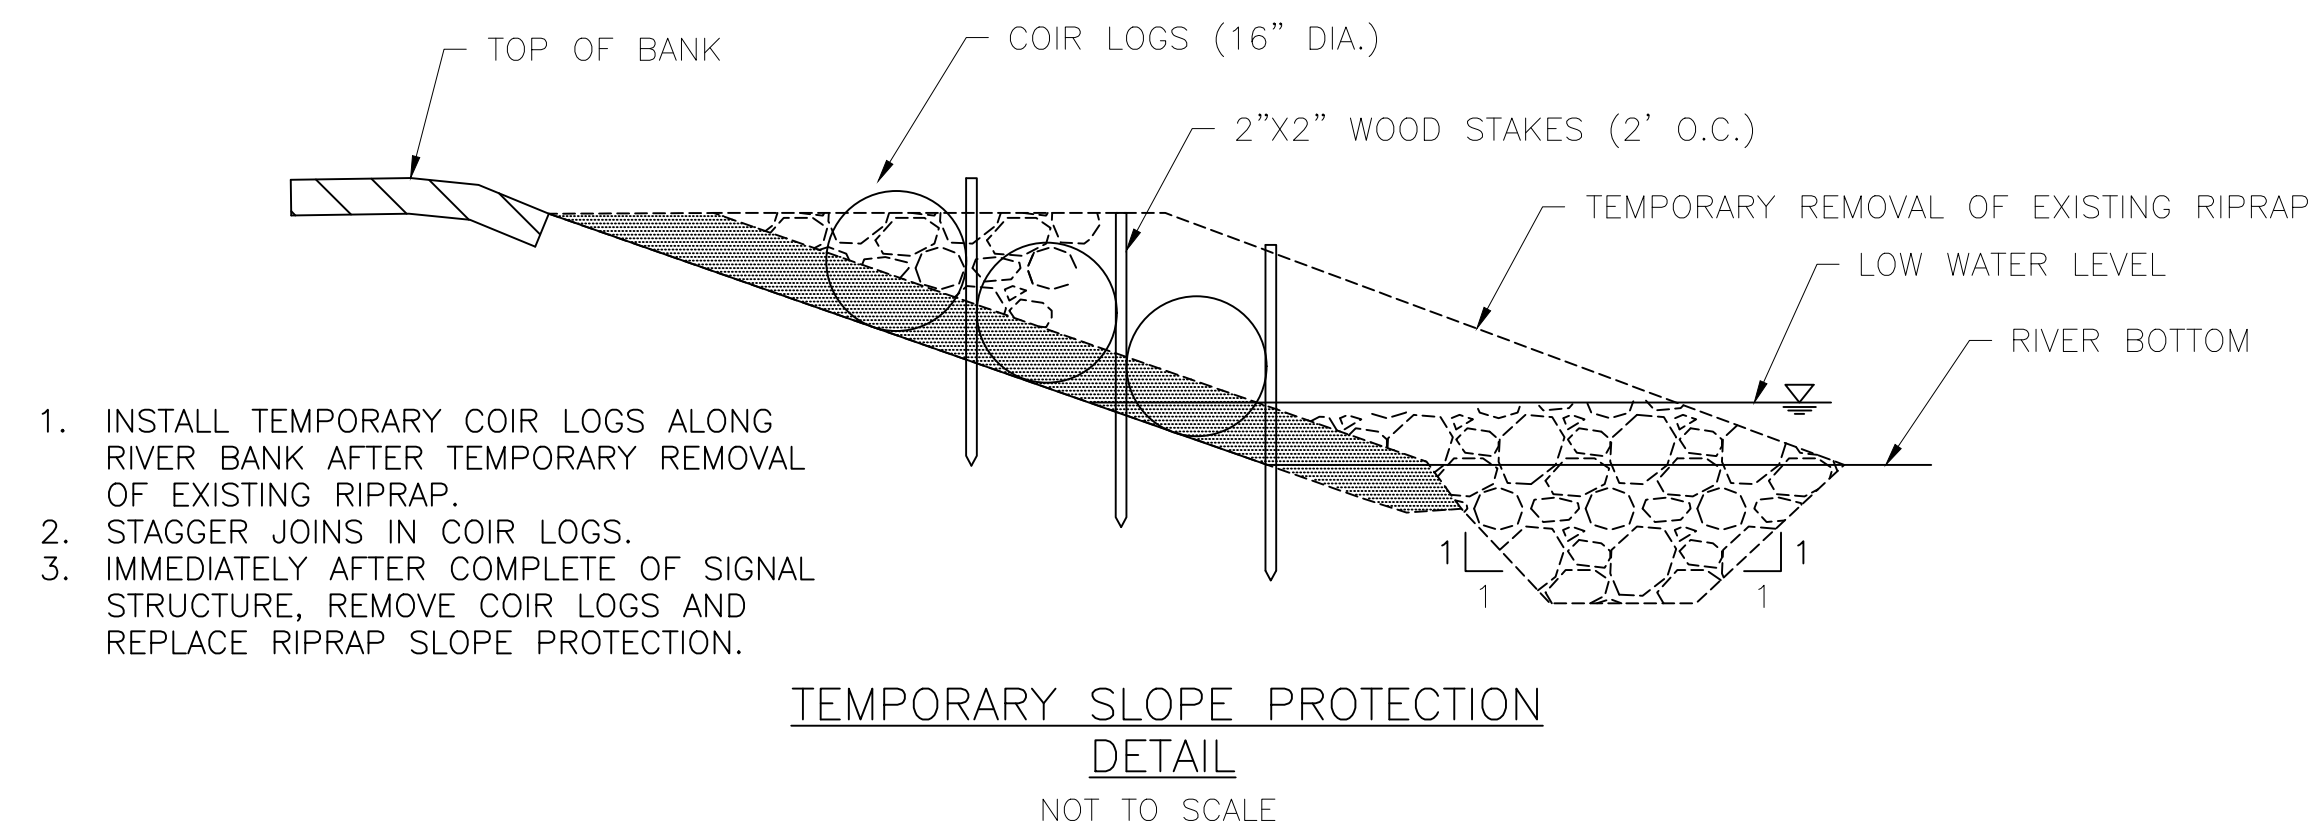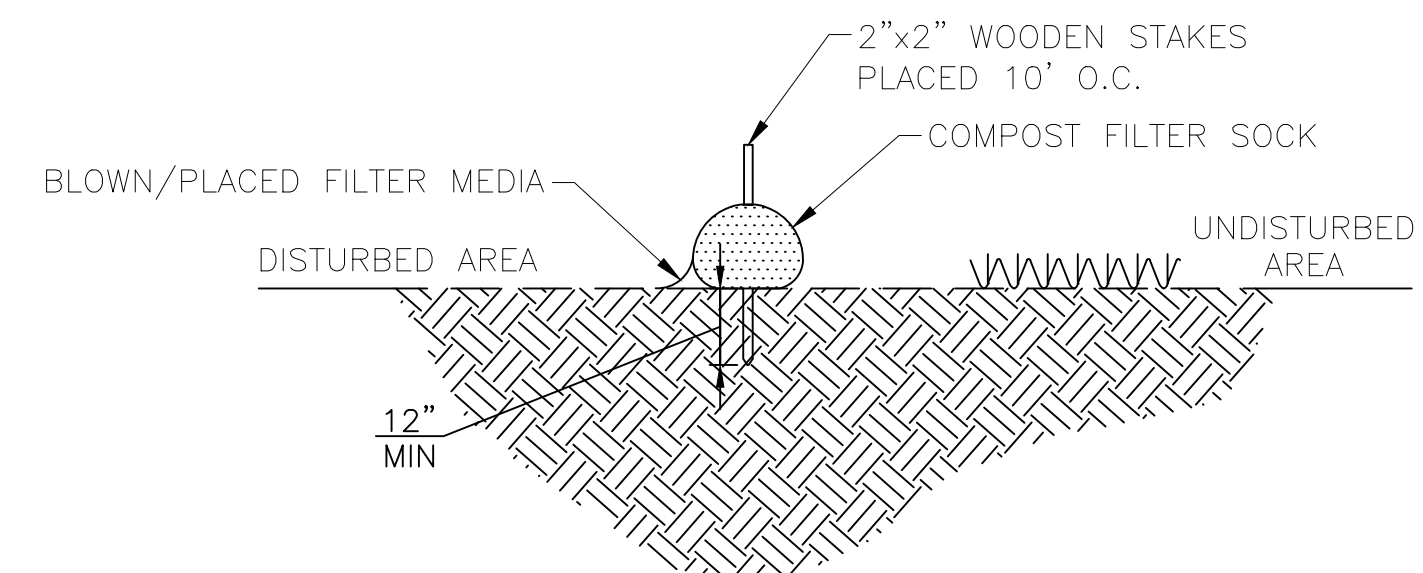

95% SUBMISSION

[illegible]

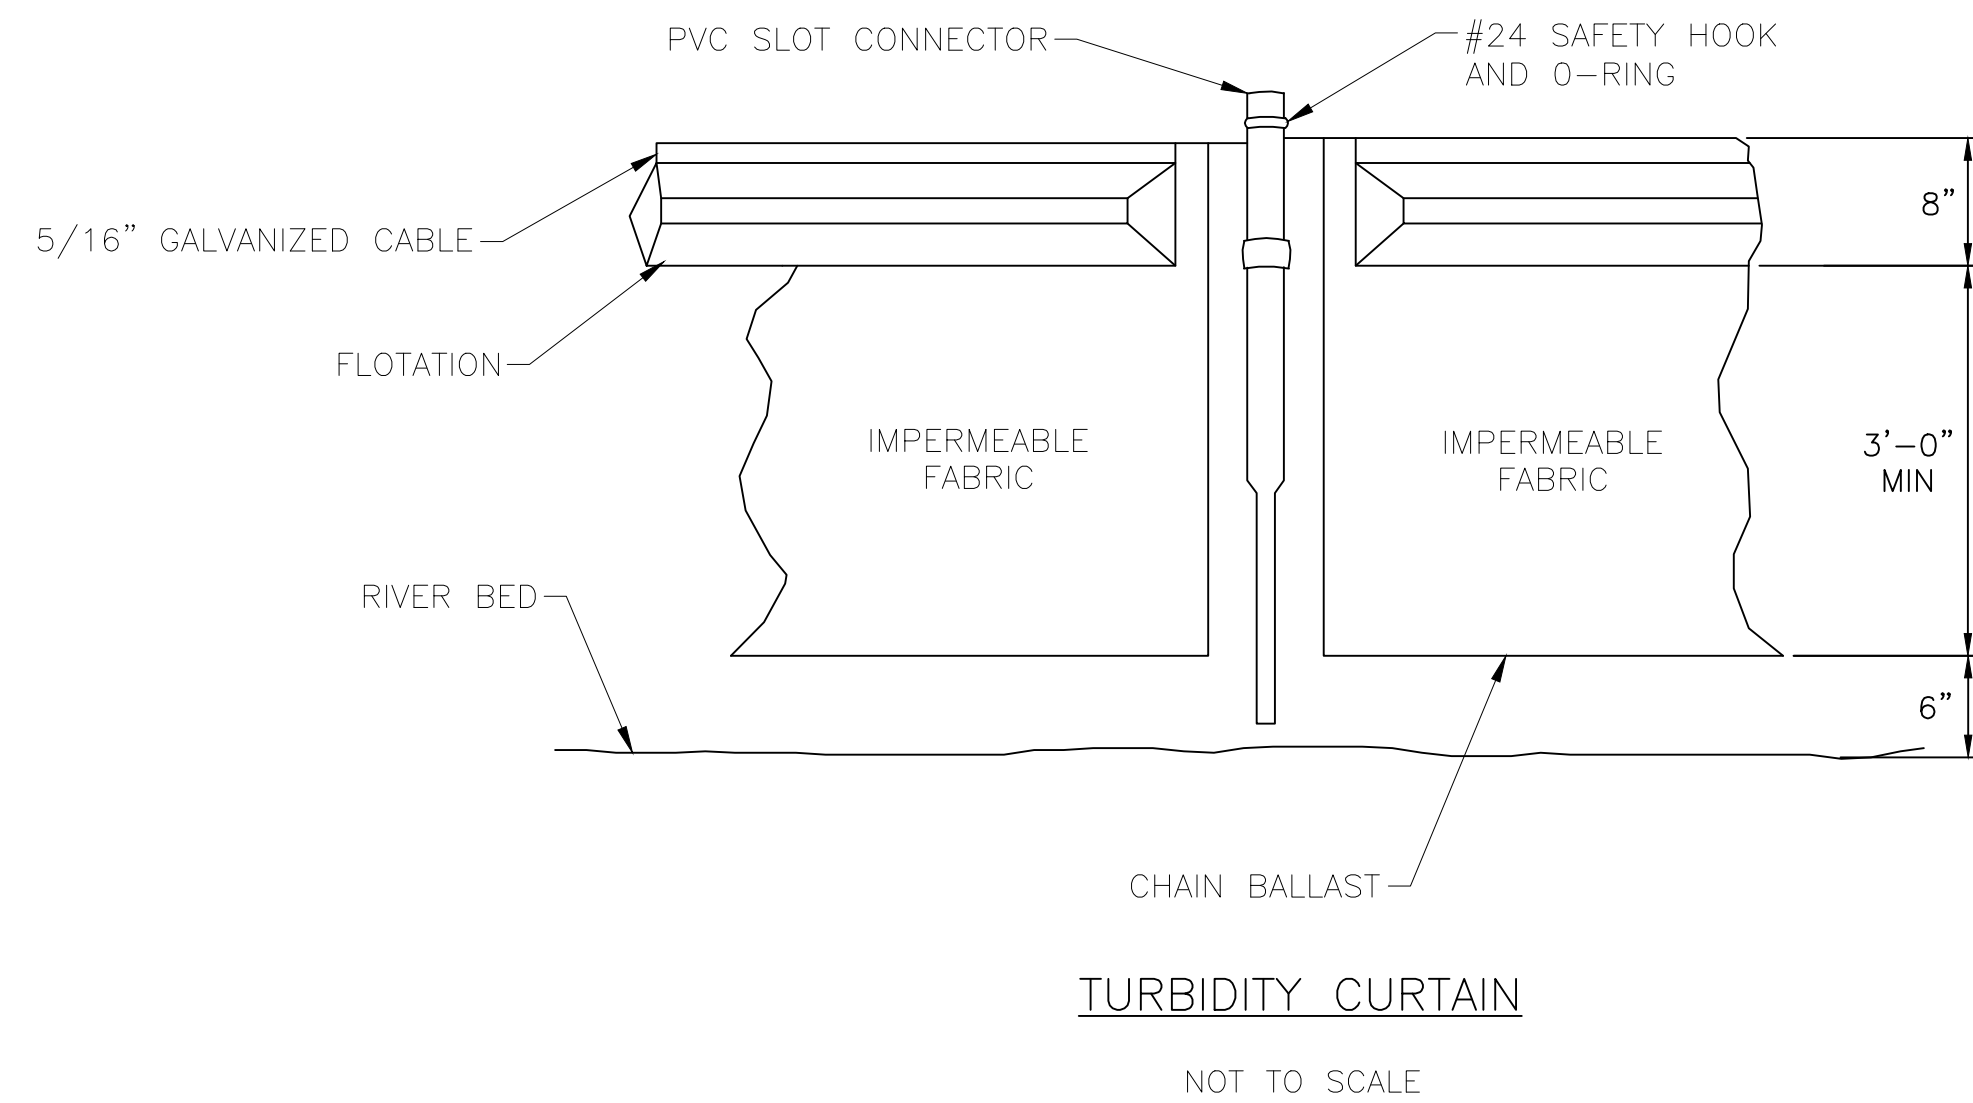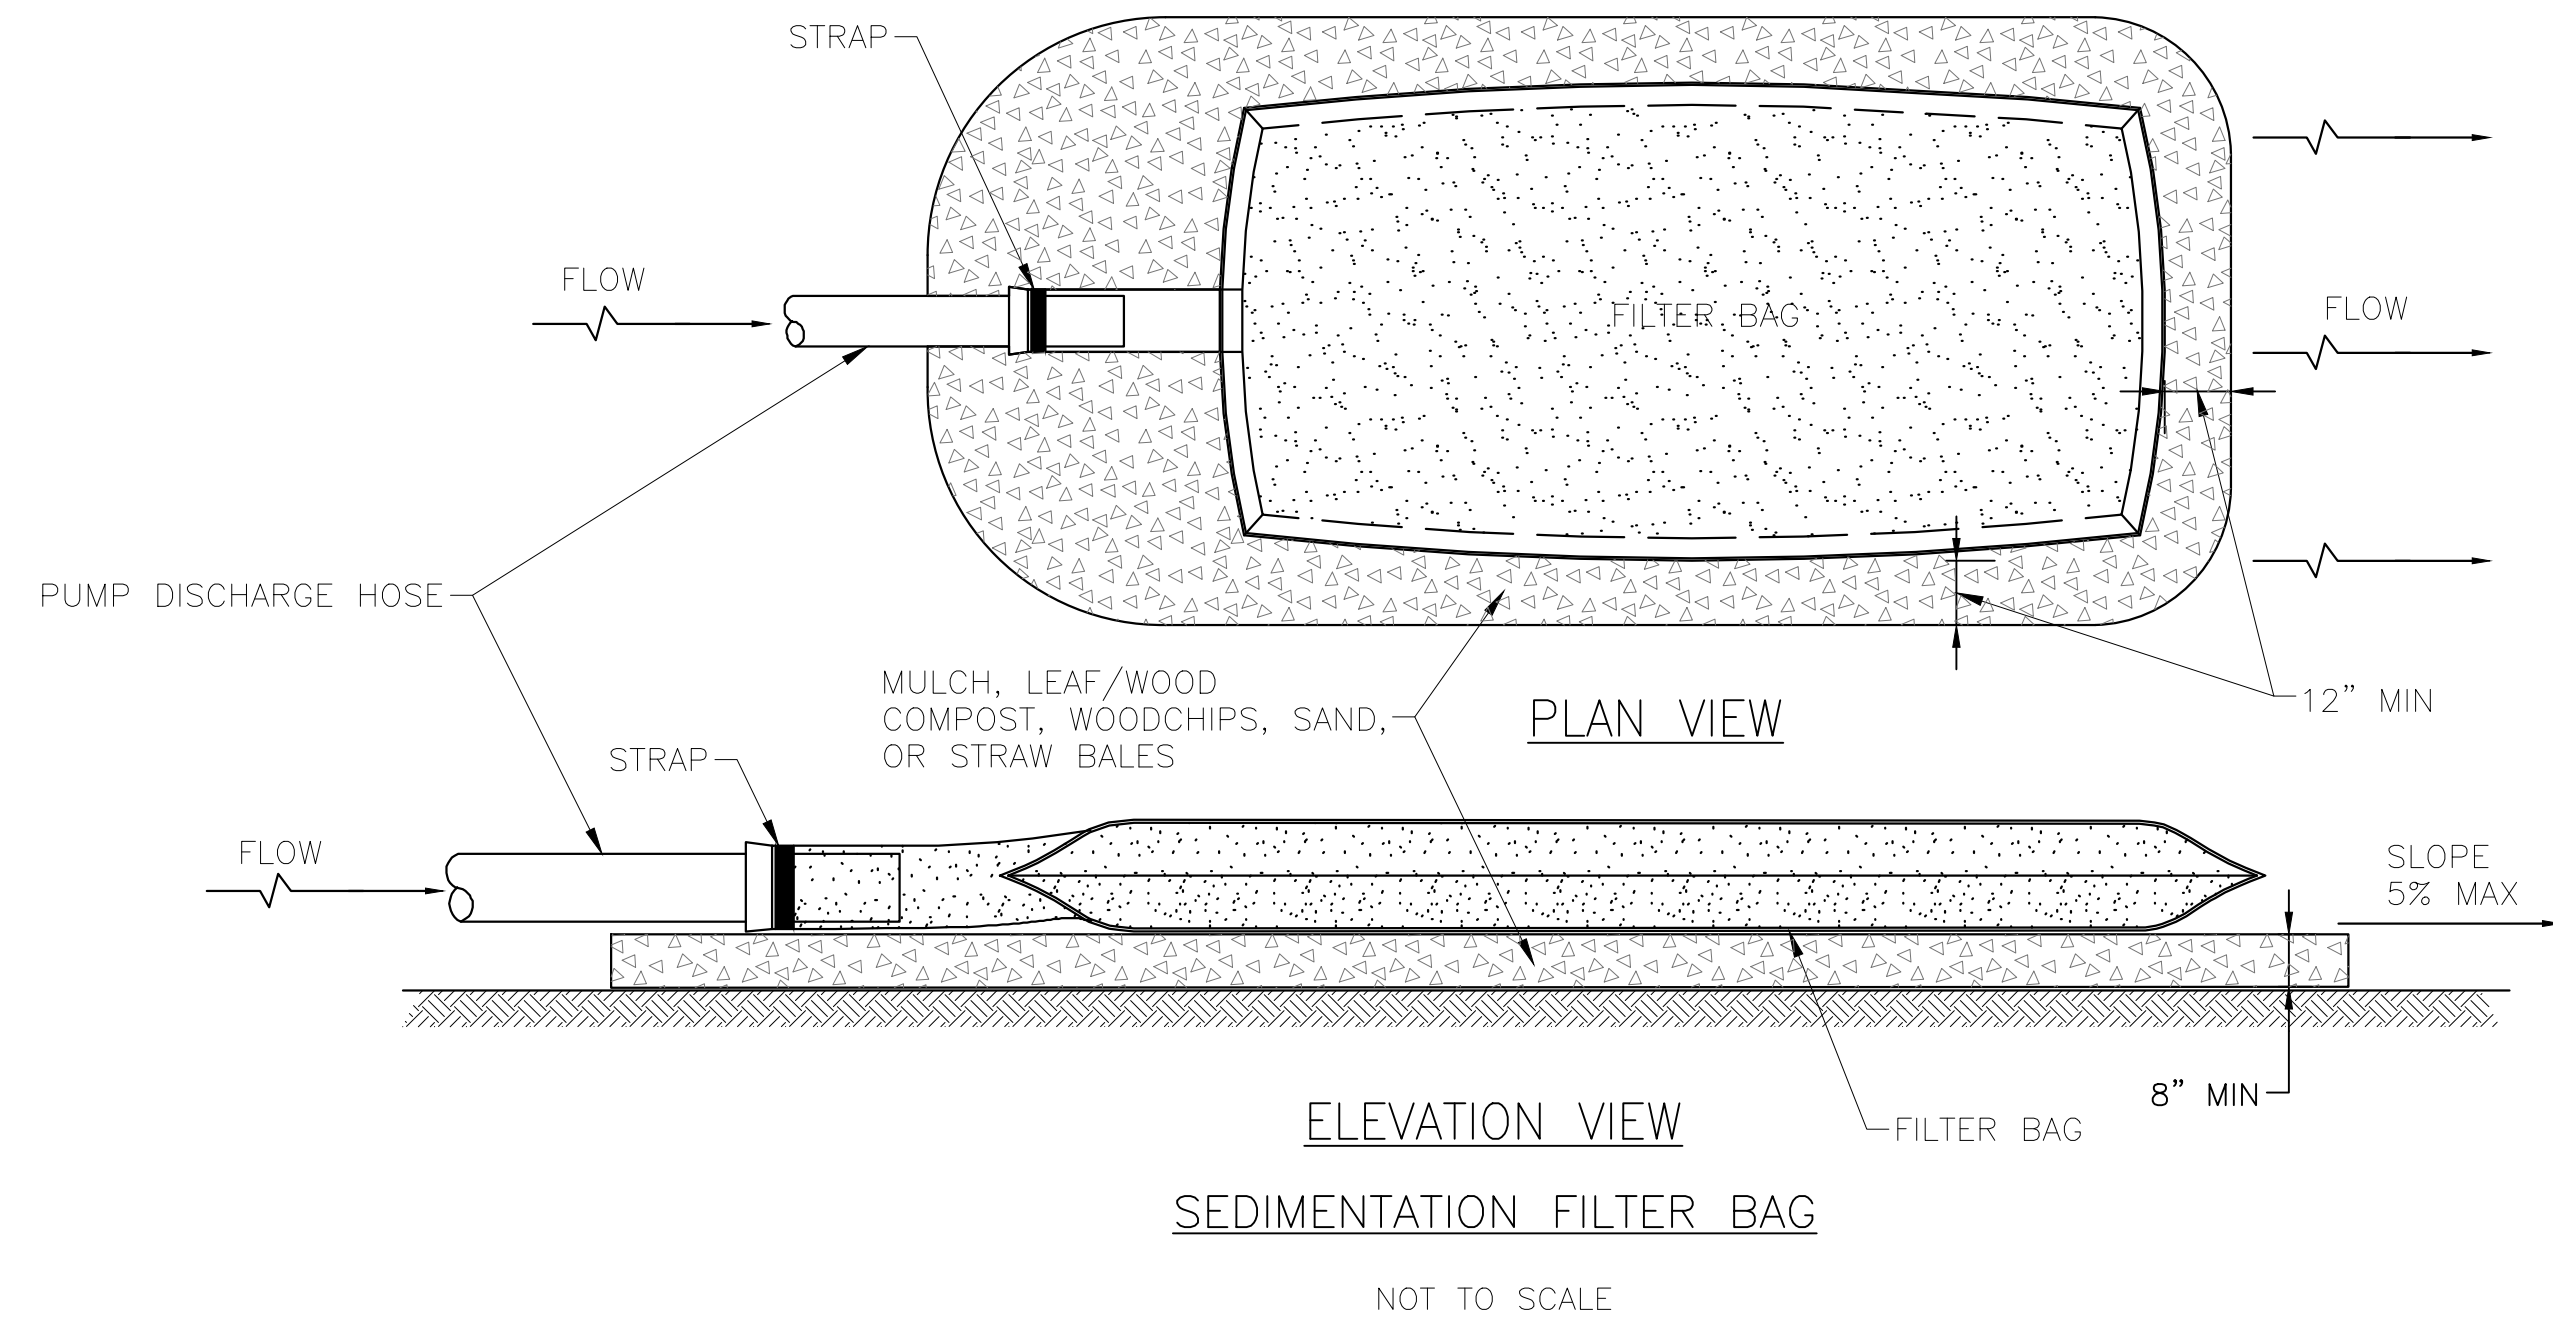

95% SUBMISSION

												CONTRACT NUMBER		39462	
												SCALE:	AS SHOWN	DATE:	11/04/2022
												DRAWING NUMBER		CIV-005	
												SHEET	21	OF	610
												HUDSON LINE C&S IMPROVEMENTS EQUIPMENT INSTALLATIONS MP-32 TO MP-76			
												CIVIL INFORMATION TEMPORARY SLOPE PROTECTION DETAILS SHEET 2 OF 2			
												DESIGNED G.E.			
												DRAWN J.L.B.			
												CHECKED G.E.			
												APPROVED A.E.M.			
												Gannett Fleming / CWA Transit & Rail Systems GANNETT FLEMING/CWA, a joint venture TWO PENN PLAZA, SUITE 552 380 SEVENTH AVENUE NEW YORK, NY 10121-0101 PRJ: 059824			
												MTA Metro-North Railroad 347 MADISON AVENUE NEW YORK, N.Y. 10017			
												DISCLAIMER IT IS A VIOLATION OF THE PROFESSIONAL LICENSE LAW FOR ANY PERSON TO ALTER THIS DRAWING IN ANY WAY, UNLESS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER/ARCHITECT AS APPLICABLE. THE ALTERING ENGINEER/ARCHITECT SHALL AFFIX HIS/HER SEAL AND THE NOTATION "ALTERED BY" FOLLOWED BY HIS/HER SIGNATURE AND DATE OF ALTERATION.			
												NO. DATE MODIFICATION DRAWN CHKD. APPRVD. NO. DATE MODIFICATION DRAWN CHKD. APPRVD.			
												REVISIONS			